

# KL-4022

## Technical Documentation 2-Channel Analog Output Terminal 4...20mA

*Please keep for further use !*

Edition date/Rev. date: 27.07.1998  
Document no./Rev. no.: TRS - V - BA - GB - 0124 - 00  
Software version: 1.0  
File name: TRS-V-BA-GB-0124.DOC  
Author: KOH

**TRSystemtechnik GmbH**  
Eglisshalde 6  
D-78647 Trossingen  
Germany  
Tel. +49 - (0) 7425 / 228-0  
Fax +49 - (0) 7425 / 228-34

## **Imprint**

### **TRSystemtechnik GmbH**

D-78647 Trossingen  
Eglisshalde 6  
Tel.: (+49) 07425/228-0  
Fax: (+49) 07425/228-34

© Copyright 1998 TRSystemtechnik

## **Guarantee**

In our ongoing efforts to improve our products, TRSystemtechnik reserve the right to alter the information contained in this document without prior notice.

## **Printing**

This manual was edited using text formatting software on a DOS personal computer. The text was printed in *Arial*.

## **Fonts**

*Italics* and **bold** type are used for the title of a document or to emphasize text passages.

Passages written in *Courier* show text which is visible on the display as well as software menu selections.

"< >" refers to keys on your computer keyboard (e.g. <RETURN>).

## **Note**

Text following the "NOTE" symbol describes important features of the respective product.

## **Copyright Information ©**

MS-DOS is a registered trademark of Microsoft Corporation.

## Revision History

**i**

**Note:**

The cover of this document shows the current revision status and the corresponding date. Since each individual page has its own revision status and date in the footer, there may be different revision statuses within the document.


Document created:

27.07.1998

Revision	Date



## 2-Channel 4 to 20 mA Analog Output Terminal KL-4022

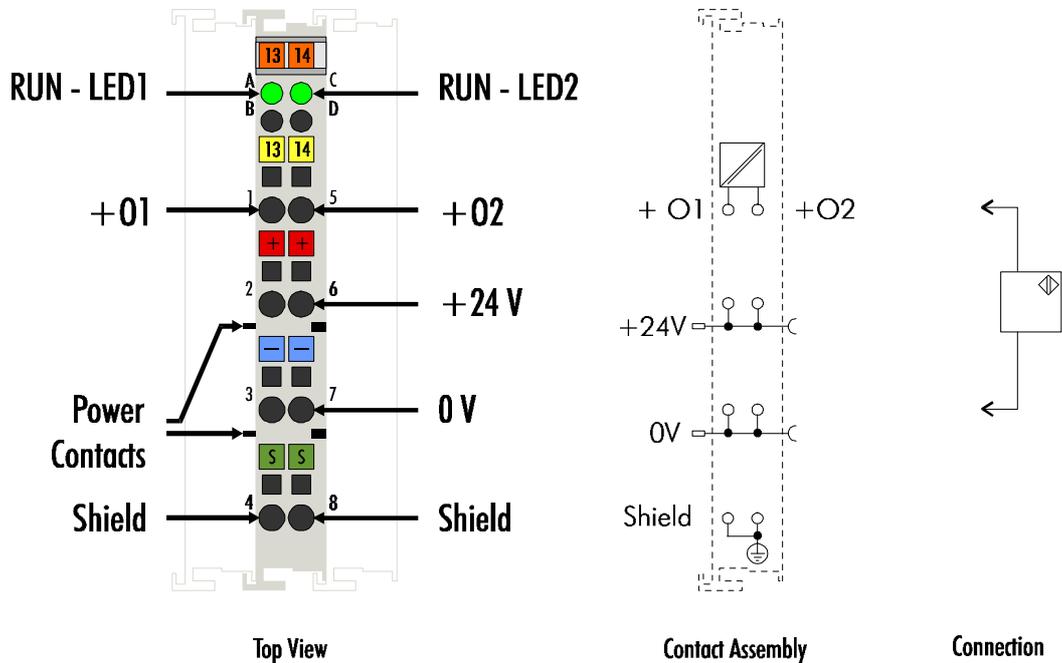

Technical Data	KL-4022
Number of outputs	2
Power supply	24 V DC via the Power contacts
Signal voltage	4 ... 20 mA
Load	< 500 Ω
Accuracy	± 0.5 LSB linearity error, ± 0.5 LSB offset error
Resolution	12 bits
Electrical isolation	500 V rms (K-bus / signal voltage)
Total conversion time	~ 1.5 ms
Current consumption of the K-bus	60 mA typ.
Bit width in the process image	O: 2 x 16 bits cata, (2 x 8 bits control/status can be optionally inserted)
Configuration	no address or configuration setting
Weight approximately	80 g
Operating temperature	0°C ... +55°C
Storage temperature	-25°C ... +85°C
Relative humidity	95%, no condensation
Vibration/schock resistance	In accordance with IEC 68-2-6 / IEC 68-2-27
EMC resistance Burst / ESD	In accordance with EN 61000-4-4 / EN 61000-4-2 Limits in accordance with EN 50082-2
Installation position	any
Degree of protection	IP20

## Description of functions

The analog output terminal KL-4022 generates output signals within the range from 4 – 20 mA. The output current is output by the terminal with a 12-bit resolution (4096 increments). The output current is electrically isolated from the terminal bus level.

The supply voltage fed in via the Power contacts is used to generate the output current.

### Input format of process data

In the default setting, process data is entered in twos complement (-1 corresponds to 0xFFFF).

Process data item (Hex/decimal)	Output value
0x0000 (0)	4 mA
0x3FFF (16383)	12 mA
0x7FFF (32767)	20 mA

### LED Display

The two RUN LEDs indicate the operating state of the affiliated terminal channel.

RUN LED:

On – normal operation

Off – watchdog-timer overflow has occurred. The green LEDs go off if no process data is transferred by the bus coupler for 100 ms. The output outputs a current that is configurable by the user (see feature register).

### Process data

The process data arriving from the bus coupler is output to the process as follows.

X = Process data of the PLC

B<sub>h</sub>,A<sub>h</sub> = Manufacturer scaling (R19,R20)

B<sub>w</sub>,A<sub>w</sub> = User scaling (R33,R34)

Y<sub>dac</sub> = Output value to the DA converter

Neither user nor manufacturer scaling active:

$$Y_{dac} = X \quad (1.0)$$

Manufacturer scaling active:

$$Y_1 = B_h + A_h * X \quad (1.1)$$

$$Y_{dac} = Y_1$$

User scaling active:

$$Y_2 = B_w + A_w * X \quad (1.2)$$

$$Y_{dac} = Y_2$$

Manufacturer and user scaling active:

$$Y_1 = B_h + A_h * X \quad (1.3)$$

$$Y_{dac} = B_w + A_w * Y_1 \quad (1.4)$$

The straight-line equations are activated via R32.


### Terminal configuration

The terminal can be configured and parametrized by way of the internal register structure.

Each terminal channel is mapped in the bus coupler. The terminal's data is mapped differently in the bus coupler's memory depending on the type of the bus coupler and on the set mapping configuration (eg. Motorola / Intel format, word alignment,...). For parametrization of a terminal, the control/status byte must also be mapped.


*TRS Lightbus  
Coupler BK2000*

In the case of the TRS-Lightbus coupler BK2000, the control /status byte is always mapped besides the data bytes. It is always in the low byte at the offset address of the terminal channel.

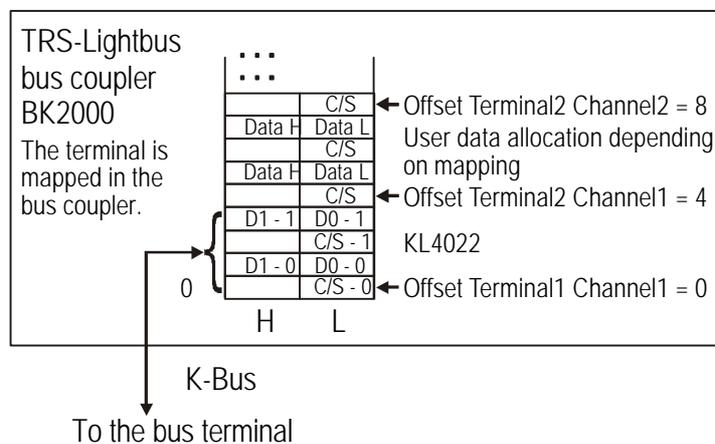


*Profibus Coupler BK3000*

In the case of the Profibus coupler BK3000, for which terminal channels the control /status byte is also to be inserted must be defined in the master configuration. If the control /status byte is not evaluated, the KL-4022 occupies 4 bytes of output data (2 bytes of user data per channel).

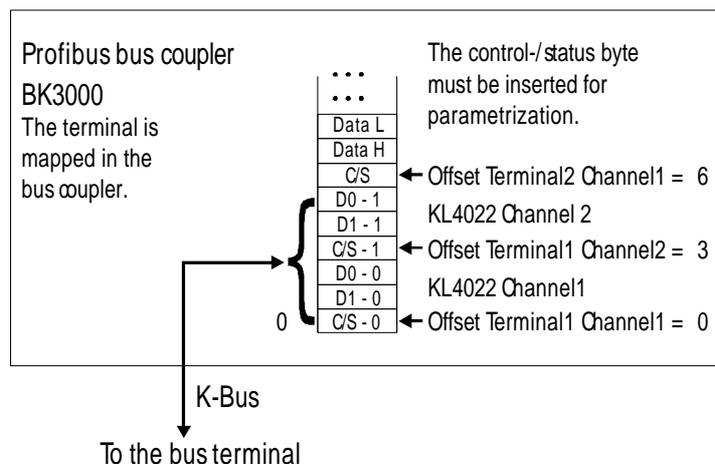

*Interbus Coupler BK4000*

By default, the Interbus coupler BK4000 maps the KL-4022 with 4 bytes of output data (2 bytes of user data per channel). Parametrization via the field bus is not possible. The KS2000 software is needed for configuration if it is intended to use the control / status byte.

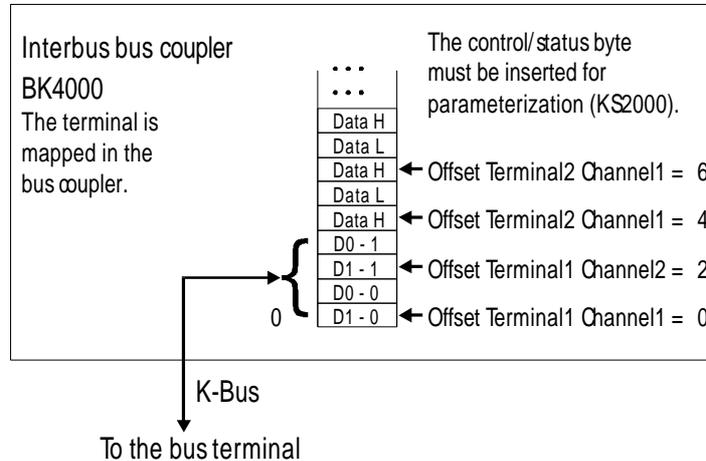

*Other bus couplers and further information*

You will find further information on the mapping configuration of bus couplers in the annex of the respective bus coupler manual under the heading of "Configuration of Masters".

*Reference*

The annex contains an overview of the possible mapping configurations depending on the adjustable parameters.

*Parametrization with the KS2000 software*

Parametrization operations can be carried out independently of the field bus system using the TRS KS2000 configuration software via the serial configuration interface in the bus coupler.

**KL-4022 register communication**

*General register description*

Complex terminals that possess a processor are capable of bidirectionally exchanging data with the higher-level control system. Below, these terminals are referred to as intelligent bus terminals. They include the analog inputs (0-10V, -10-10V, 0-20mA, 4-20mA), the analog outputs (0-10V, -10-10V, 0-20mA, 4-20mA), serial interface terminals (RS485, RS232, TTY, data transfer terminals), counter terminals, the encoder interface, the SSI interface, the PWM terminal and all other parametrizable terminals.

Internally, all intelligent terminals possess a data structure that is identical in terms of its essential characteristics. This data area is organized in words and embraces 64 memory locations. The essential data and parameters of the terminal can be read and adjusted by way of this structure. Function calls with corresponding parameters are also possible. Each logical channel of an intelligent terminal has such a structure (therefore, 4-channel analog terminals have 4 register sets).

This structure is broken down into the following areas:  
(You will find a list of all registers at the end of this documentation).

Area	Address
Process variables	0-7
Type registers	8-15
Manufacturer parameters	16-31
User parameters	32-47
Extended user area	48-63

*Process variables*

**R0 - R7 Registers in the terminal's internal RAM**

The process variables can be used in addition to the actual process image and their functions are specific to the terminal.

**R0 - R5:** These registers have a function that depends on the terminal type.

**R6: Diagnostic register**

The diagnostic register may contain additional diagnostic information. In the case of serial interface terminals, for example, parity errors that have occurred during data transfer are indicated.

**R7: Command register**

High-Byte\_Write = function parameter  
 Low-Byte\_Write = function number  
 High-Byte\_Read = function result  
 Low-Byte\_Read = function number

*Type registers*

**R8 - R15 Registers in the terminal's internal ROM**

The type and system parameters are programmed permanently by the manufacturer and can only be read by the user, but cannot be modified.

**R8: Terminal type**

The terminal type in register R8 is needed to identify the terminal.

**R9: Software version X.y**

The software version can be read as an ASCII character string.

**R10: Data length**

R10 contains the number of multiplexed shift registers and their length in bits. The bus coupler sees this structure.

**R11: Signal channels**

In comparison with R10, the number of logically existing channels is located here. For example, one physically existing shift register may consist of several signal channels.

**R12: Minimum data length**

The respective byte contains the minimum data length of a channel to be transferred. The status byte is omitted if the MSB is set.

### R13: Data type register

Data type register	
0x00	Terminal without valid data type
0x01	Byte array
0x02	1 byte n bytes structure
0x03	Word array
0x04	1 byte n words structure
0x05	Double word array
0x06	1 byte n double words structure
0x07	1 byte 1 double word structure
0x08	1 byte 1 double word structure
0x11	Byte array with a variable logical channel length
0x12	1 byte n bytes structure with a variable logical channel length (eg 60xx)
0x13	Word array with a variable logical channel length
0x14	1 byte n words structure with a variable logical channel length.
0x15	Double word array with a variable logical channel length
0x16	1 byte n double words structure with a variable logical channel length

R14: not used

### R15: Alignment bits (RAM)

The analog terminal is set to a byte limit in the terminal bus with the alignment bits.

#### Manufacturer Parameters

### R16 - R30 is the area of the "Manufacturer Parameters" (SEEROM)

The manufacturer parameters are specific to each terminal type. They are programmed by the manufacturer, but can also be modified from the control system. The manufacturer parameters are stored permanently in a serial EEPROM in the terminal and are therefore not destroyed by power failures.

These registers can only be modified after setting a code word in R31.

#### User Parameters

### R31 R47 " Application Parameters" area (SEEROM)

The application parameters are specific to each terminal type. They can be modified by the programmer. The application parameters are stored permanently in an serial EEPROM in the terminal and cannot be destroyed by power failures. From software version 2.A, the user area is write-protected by way of a code word.

### R31: Code word register in the RAM

The code word 0x1235 must be entered here to enable modification of parameters in the user area. Write protection is set if a different value is entered in this register. When write protection is inactive, the code word is returned during reading of the register. The register contains the value zero when write protection is active.

### R32: Feature register

This register defines the operating modes of the terminal. For example, a user-specific scaling can be activated for the analog I/O's.

### R33 - R47

Registers that depend on the terminal type

*Extended application area* R47 - R63

These registers have not yet been implemented.

*Register access via process data transfer.*

*bit 7=1: register mode*

When bit 7 of the control byte is set, the first two bytes of the user data are not used for process data transfer, but are written into or read out of the terminal's register set.

*bit 6=0: read*  
*bit 6=1: write*

In bit 6 of the control byte, you define whether a register is to be read or written. When bit 6 is not set, a register is read without modification. The value can be taken from the input process image.

When bit 6 is set, the user data is written into a register. The operation is concluded as soon as the status byte in the input process image has assumed the same value as the control byte in the output process image.

*Bits 0 to 5: address*

The address of the register to be addressed is entered in bits 0 to 5 of the control byte.

*Control byte in the register mode*

MSB

REG=1	W/NR	A5	A4	A3	A2	A1	A0
-------	------	----	----	----	----	----	----

REG = 0 : Process data transfer


REG = 1 : Access to register structure

W/NR = 0 : Read register

W/NR = 1 : Write register

A5..A0 = Register address

A total of 64 registers can be addressed with the addresses A5...A0.

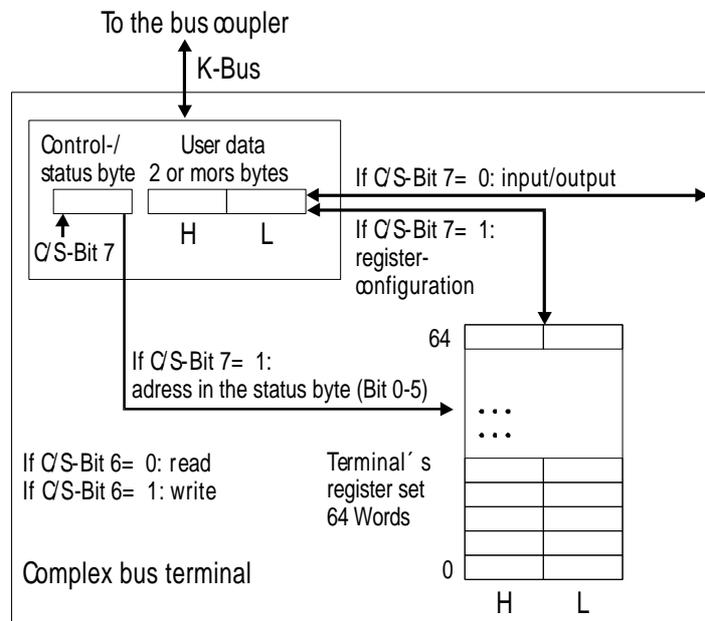

The control or status byte occupies the lowest address of a logical channel. The corresponding register values are located in the following 2 data bytes (the BK2000 is an exception to this rule: here, an unused data byte is inserted after the control or status byte, thus setting the register value to a word limit).

*Example*

Reading register 8 in the BK2000 with a KI3022 and the end terminal.

If the following bytes are transferred from the controller to the the terminal

Byte0	Byte1	Byte2	Byte3
0x88	0xXX	0xXX	0xXX

the terminal returns the following tyte designation (0xBCE corresponds to the unsigned integer 3022)

Byte0	Byte1	Byte2	Byte3
0x88	0x00	0xCE	0x0B

*A further example*

Writing register 31 in BK2000 with an intelligent terminal and the end terminal.

If the following bytes (user code word) are transferred from the controller to the terminal,

Byte0	Byte1	Byte2	Byte3
0xDF	0xXX	0x12	0x35

the user code word is set and the terminal returns the register address with the bit 7 for register access as the acknowledgement.

Byte0	Byte1	Byte2	Byte3
0x9F	0x00	0x00	0x00

*Terminal-specific register description  
Process variables*

**R0 - R4: no function**

**R5: Raw DAC value Y\_dac**

The 12-bit value that is transferred to the DAC is referred to as the raw DAC value. This is calculated from the process data via manufacturer and user scaling.

**R6 - R7: no function**

*Manufacturer parameters*

**R16: Hardware version number**

The terminal's hardware version number is stored in this register.

**R17: Offset – Hardware**

Hardware offset adjustment (8-bit digital potentiometer) of the terminal is realized via this register. The register is transferred to the hardware after every processor reset or every write access to R17. Attention must be paid to the fact that the offset to be transferred does not correspond to the DAC values

HB = don't care

LB = offset value, 0 – 255

**R18: Gain-Hardware**

Hardware gain adjustment (8-bit digital potentiometer) of the terminal is realized via this register. The register is transferred to the hardware after every processor reset or every write access to R17.

HB = don't care

LB = gain value, 0 – 255

**R19: Manufacturer offset B\_h**

**16 bit signed integer [0x0000]**

This register contains the offset of the manufacturer's straight-line equation (1.1). The straight-line equation is activated via R32.

**R20: Manufacturer scaling A\_h**

**16 bit unsigned integer \* 2<sup>-8</sup> [0x0020]**

This register contains the scaling factor of the manufacturer's straight-line equation (1.1). The straight-line equation is activated via R32.

A 1 corresponds to the register value 0x0100

**R21: Manufacturer activation value**

**[0 mA], 12 bit unsigned integer in X [0x0000]**

The manufacturer activation value is applied to the output of the terminal after a system reset or a watchdog timer overflow (terminal has not received any process data for 100ms).

The manufacturer activation value is activated via R32.

*Application parameters*

**R32: Feature Register:**

[0x0006]

Feature Bit No.		Mode description
Bit 0	1	User scaling (1.2) active [0]
Bit 1	1	Manufacturer scaling (1.1) active [1]
Bit 2	1	Watchdog timer active [1] The watchdog timer is on by default. In the event of a watchdog overflow, either the manufacturer or the user activation value is applied to output of the terminal.
Bit 3 - 7	-	not used
Bit 8	0/1	0: manufacturer activation value [0] 1: user activation value
Bits 9 - 15	-	not used

**R33: User offset B\_w**

16 bit signed Integer [0x0000]

This register contains the offset of the user straight-line equation (4.1). The straight-line equation is activated via R32.

**R34: User scaling A\_w**

16 bit signed Integer \* 2<sup>-8</sup> [0x0100]

This register contains the scaling factor of the user straight-line equation (4.1) The straight-line equation is activated via R32.

**R35: User activation value Y\_2**

16 bit signed Integer [0x0000]

If the user activation value in R32 is activated, this value is applied to the output of the terminal after a system reset or a watchdog timer overflow (terminal has not received any process date for 100ms).

*CONTROL byte  
in process data transfer  
Gain and offset adjustment*

The control byte is transferred from the controller to the terminal. It can be used in the register mode (REG = 1) or in process data transfer (REG = 0). The gain and offset of the terminal can be adjusted with the control byte (process data transfer). The code word must be entered in R31 to enable adjustment of the terminal. The terminal's gain and offset can then be adjusted.

The parameters are not permanently stored until the code word is reset!

**Control byte:**

Bit7 = 0

Bit6 = 1 Terminal adjustment function is active

Bit4 = 1 gain adjustment

Bit2 = 0 slow clock = 1000ms  
1 fast clock = 50ms

Bit1 = 1 up

Bit0 = 1 down

Bit3 = 1 offset adjustment

Bit2 = 0 slow clock = 1000ms  
1 fast clock = 50ms

Bit1 = 1 up

Bit0 = 1 down

*STATUS byte  
in process data transfer*

The status byte is transferred from the terminal to the controller. In the case of the KL-4022, the status byte has no function in process data transfer.

## Annex

As already described in the chapter on terminal configuration, each bus terminal is mapped in the bus coupler. In the standard case, this mapping is done with the default setting in the bus coupler/bus terminal. This default setting can be modified with the TRS KS2000 configuration software or using master configuration software (e.g. ComProfibus). The following tables provide information on how the KL-4022 maps itself in the bus coupler depending on the set parameters.

*Mapping in the bus coupler* The KL-4022 is mapped in the bus coupler depending on the set parameters. If the terminal is evaluated completely, the terminal occupies memory space in the process image of the inputs and outputs.

*Default: CAN CAL, CANopen,*

### DeviceNet

		I/O Offset	High Byte	Low Byte
Complete evaluation	= 0	3		
MOTOROLA format	= 0	2		
Word alignment	= X	1	D1 - 1	D0 - 1
		0	D1 - 0	D0 - 0

*Default: Profibus, Interbus*

		I/O Offset	High Byte	Low Byte
Complete evaluation	= 0	3		
MOTOROLA format	= 1	2		
Word alignment	= X	1	D0 - 1	D1 - 1
		0	D0 - 0	D1 - 0

		I/O Offset	High Byte	Low Byte
Complete evaluation	= 1	3		
MOTOROLA format	= 0	2	D1 - 1	D0 - 1
Word alignment	= 0	1	CT/ST - 1	D1 - 0
		0	D0 - 0	CT/ST - 0

		I/O Offset	High Byte	Low Byte
Complete evaluation	= 1	3		
MOTOROLA format	= 1	2	D0 - 1	D1 - 1
Word alignment	= 0	1	CT/ST - 1	D0 - 0
		0	D1 - 0	CT/ST - 0

		I/O Offset	High Byte	Low Byte
Complete evaluation	= 1	3	D1 - 1	D0 - 1
MOTOROLA format	= 0	2		CT/ST - 1
Word alignment	= 1	1	D1 - 0	D0 - 0
		0		CT/ST - 0

*Default: Lightbus*

		I/O Offset	High Byte	Low Byte
Complete evaluation	= 1	3	D0 - 1	D1 - 1
MOTOROLA format	= 1	2		CT/ST - 1
Word alignment	= 1	1	D0 - 0	D1 - 0
		0		CT/ST - 0

*Legend*

Complete evaluation: the terminal is mapped with control / status byte.  
Motorola format: the Motorola or Intel format can be set.  
Word alignment: the terminal is at a word limit in the bus coupler.  
CT: Control- Byte (appears in the PI of the outputs).  
ST: Status- Byte (appears in the PI of the inputs).  
D0 - 0 : D0 = Data-Low-Byte, 0 = channel 1  
D1 - 1 : D1 = Data-High-Byte, 1 = channel 2

Table of the KL-4022 register set

Address	Description	Default	R/W	Storage medium
R0	not used	0x0000	R	
R1	not used	0x0000	R	
R2	not used	0x0000	R	
R3	not used	0x0000	R	
R4	not used	0x0000	R	
R5	Raw DAC value	variable	R	RAM
R6	Diagnostic register - not used	0x0000	R	
R7	Command register - not used	0x0000	R	
R8	Terminal type	4022	R	ROM
R9	Software version number	0x????	R	ROM
R10	Multiplex shift register	0x0218	R	ROM
R11	Signal channels	0x0218	R	ROM
R12	Minimum data length	0x9800	R	ROM
R13	Data structure	0x0000	R	ROM
R14	not used	0x0000	R	
R15	Alignment register	variable	R/W	RAM
R16	Hardware version number	0x????	R/W	SEEROM
R17	Hardware offset adjustment	specific	R/W	SEEROM
R18	Hardware-gain adjustment	specific	R/W	SEEROM
R19	Manufacturer scaling: offset	0x0000	R/W	SEEROM
R20	Manufacturer scaling: gain	0x0020	R/W	SEEROM
R21	Manufacturer activation value	0x0000	R/W	SEEROM
R22	not used	0x0000	R/W	SEEROM
R23	not used	0x0000	R/W	SEEROM
R24	not used	0x0000	R/W	SEEROM
R25	not used	0x0000	R/W	SEEROM
R26	not used	0x0000	R/W	SEEROM
R27	not used	0x0000	R/W	SEEROM
R28	not used	0x0000	R/W	SEEROM
R29	not used	0x0000	R/W	SEEROM
R30	not used	0x0000	R/W	SEEROM
R31	Code word register	variable	R/W	RAM
R32	Feature register	0x0006	R/W	SEEROM
R33	User offset	0x0000	R/W	SEEROM
R34	User gain	0x0100	R/W	SEEROM
R35	User activation value	0x0000	R/W	SEEROM
R36	not used	0x0000	R/W	SEEROM
R37	not used	0x0000	R/W	SEEROM
R38	not used	0x0000	R/W	SEEROM
R39	not used	0x0000	R/W	SEEROM
R40	not used	0x0000	R/W	SEEROM
R41	not used	0x0000	R/W	SEEROM
R42	not used	0x0000	R/W	SEEROM
R43	not used	0x0000	R/W	SEEROM
R44	not used	0x0000	R/W	SEEROM
R45	not used	0x0000	R/W	SEEROM
R46	not used	0x0000	R/W	SEEROM
R47	not used	0x0000	R/W	SEEROM